



# Metering, Monitoring, and Verification

***APPA Institute for  
Facilities Management  
June 26, 2024  
San Antonio, TX***



# Purpose of Today's Presentation

- To provide a broad understanding of:
  - How to pick a meter
  - How to collect the meter outputs
  - How to convert data into information

# Agenda

- Metering
  - Definitions
  - Basic Applications
- Monitoring
  - Manual
  - Automatic
- Verification
  - Converting data into information
  - Metrics

# WORDS OF WISDOM

You *can* manage what you don't measure, but



If you don't measure, you're just guessing

# Terminology

- **Sensor**: An instrument for monitoring, measuring, or recording of a measured variable, e.g., volumetric flow, pressure, temperature, amperage, voltage, etc.
- **Meter**: A sensor, or group of sensors, used to measure a calculated variable, e.g, mass flow, BTU, tons of refrigeration, KW, etc.
- **Resolution**: The smallest change in a measured value that the instrument can detect, also known as sensitivity.
- **Accuracy**: How close a measured value is to the **actual (true) value**. (% of RATE, % of FULL SCALE)
- **Precision (Repeatability)**: How close the measured values are to each other



Low Accuracy  
High Precision

High Accuracy  
Low Precision

High Accuracy  
High Precision

# Terminology (cont.)

- **Error:** The disagreement between a measurement and the true or accepted value
- **Bias:** A systematic (built-in) error which shifts all measurements by a certain amount.
- **Instrument Range:** The interval between the minimum and maximum values of the measured variable in which the instrument is accurate
- **Volumetric Flow Rate:** The flow of the fluid measured as:  
$$q = A \times V$$
*where:*
  - $q$  = volumetric flow,  $\text{ft}^3/\text{min}$ ,  $\text{m}^3/\text{sec}$ ,  $\text{gal}/\text{min}$ , etc.
  - $A$  = area of the pipe,  $\text{in}^2$ ,  $\text{cm}^2$ , etc
  - $V$  = velocity,  $\text{ft}/\text{min}$ ,  $\text{m}/\text{sec}$ , etc.
- **Mass or Energy Flow Rate:** The actual quantity or energy of fluid, i.e. pounds per hour, BTU/min. tons, etc. Requires knowledge of fluid and its properties. For example:

## Mass

*A cubic foot of air weighs about .075 lbs.; a cubic foot of water weighs about 825 times as much, 62 lbs.*

## Energy

*A pound of propane contains about 21,000 BTU; a pound of hydrogen is about 3 times greater; 61,000 BTU*

# Flow Meters


## Positive Displacement meters



The positive displacement flow meter measures process fluid flow by precision-fitted rotors as flow measuring elements. Known fixed volumes are displaced between the rotors. The rotation of the rotors are proportional to the volume of the fluid being displaced.





The number of rotations of the rotor is counted by an integral electronic pulse transmitter and converted to volume and flow rate.

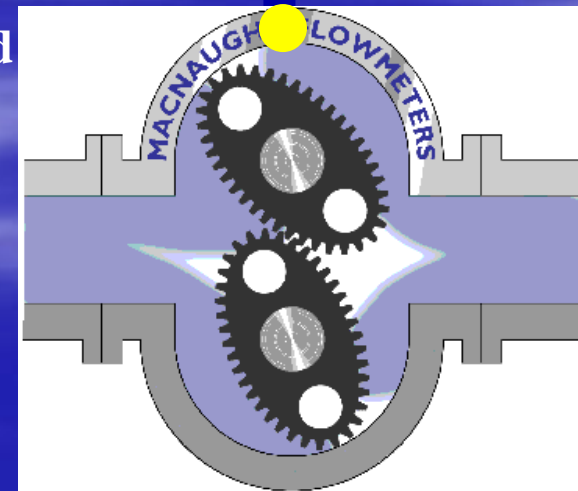

# Flow Meters

## Pressure Differential

In a pressure differential device the flow is calculated by measuring the pressure drop over an obstruction inserted in the flow. The differential pressure device is based on Bernoulli's Equation, where the flow velocity is a function of the square root of the pressure drop.

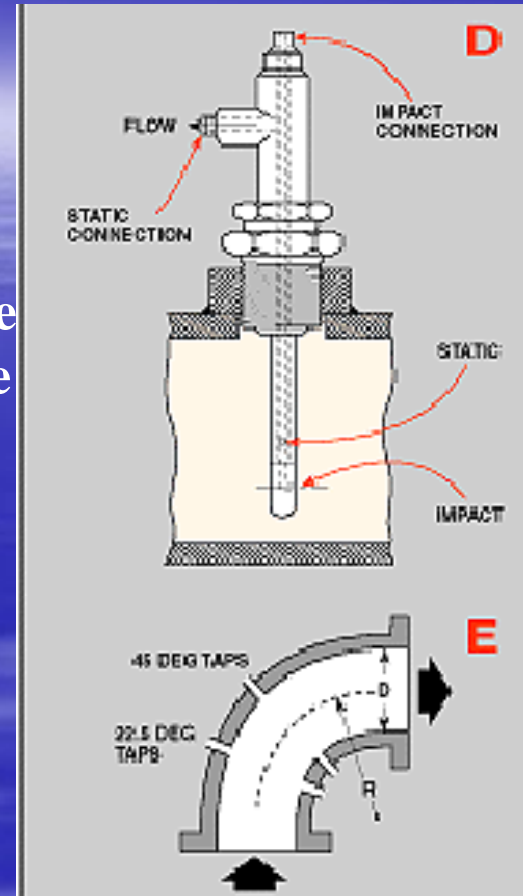
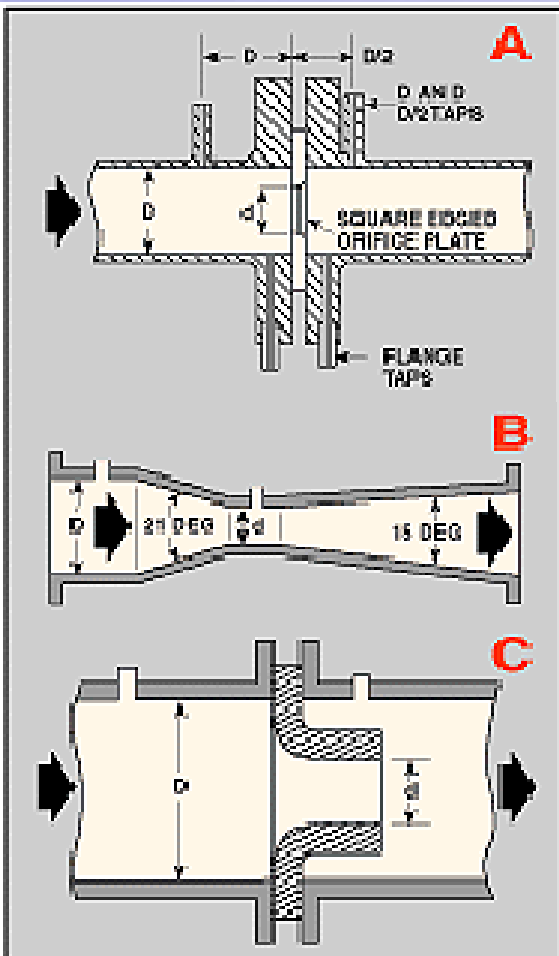


- A. Orifice
- B. Venturi
- C. Flow nozzle
- D. Pitot Tube
- E. Elbow Tap




# Flow Meters

## Turbine

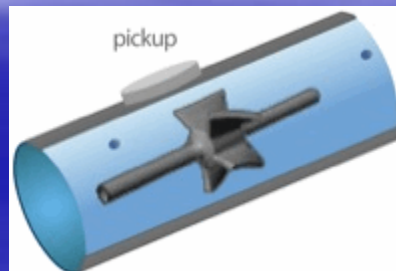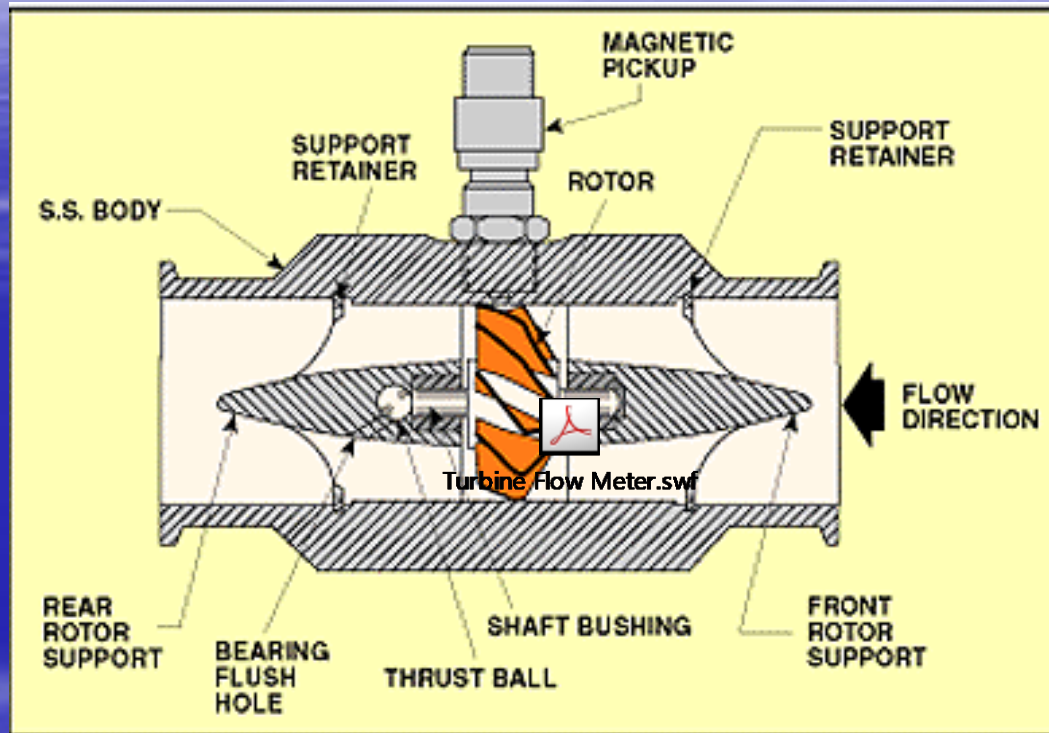


# Flow Meters

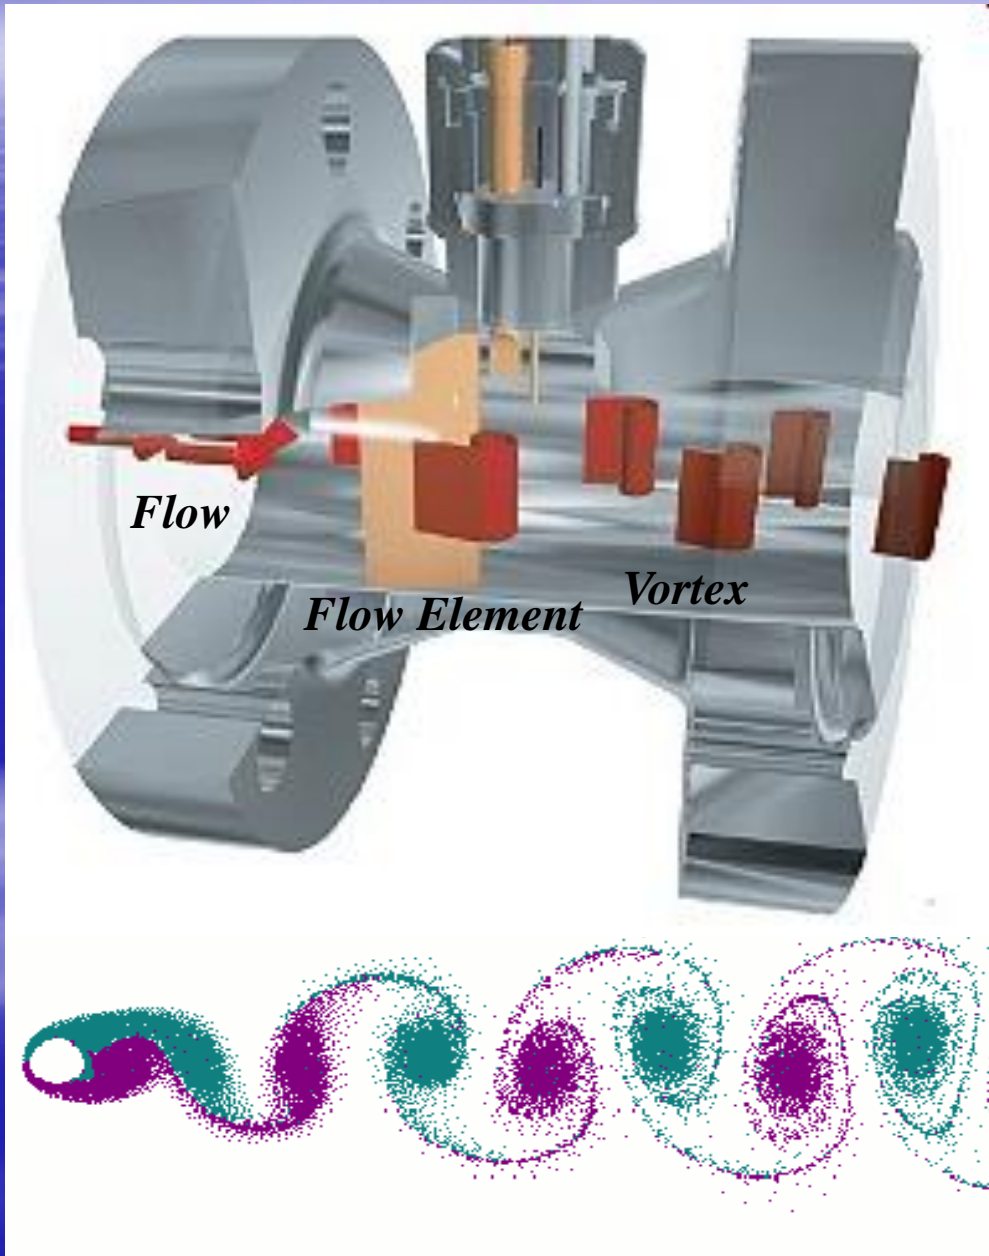

## Vortex



Vortex meters operate on the principle that when a non-streamlined object is placed in the middle of a flow stream, a series of vortices are shed alternately downstream of the object (Von Karman vortex street). The frequency of the vortex shedding is directly proportional to the velocity of the fluid flow.

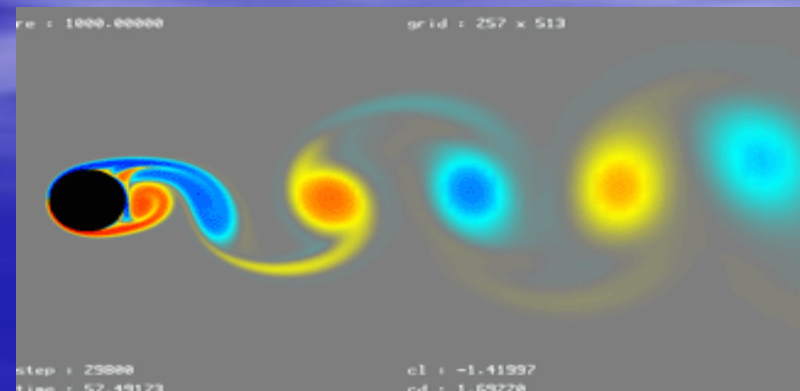

# Flow Meters

## Electromagnetic



Magnetic flow meters are based on Faraday's Law of Magnetic Induction. In a magnetic flow meter, the liquid acts as a conductor as it flows through the pipe. This induces a voltage which is proportional to the average flow velocity - the faster the flow rate, the higher the voltage. This voltage is picked up by sensing electrodes mounted in the meter tube and sent to the transmitter which takes the voltage and calculates the flow rate based on the cross sectional area of the meter tube.

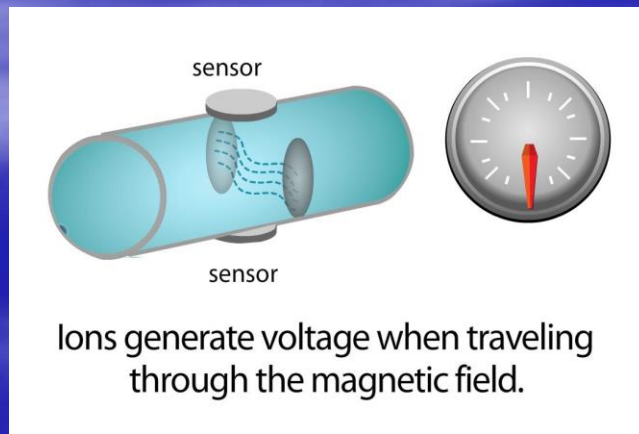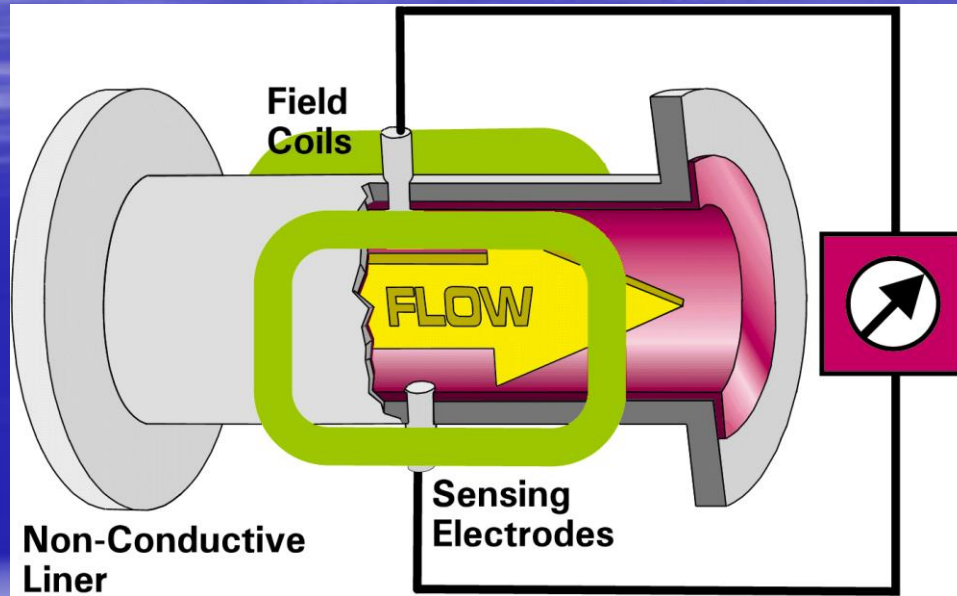


Ions generate voltage when traveling through the magnetic field.

# Flow Meters

## Ultrasonic

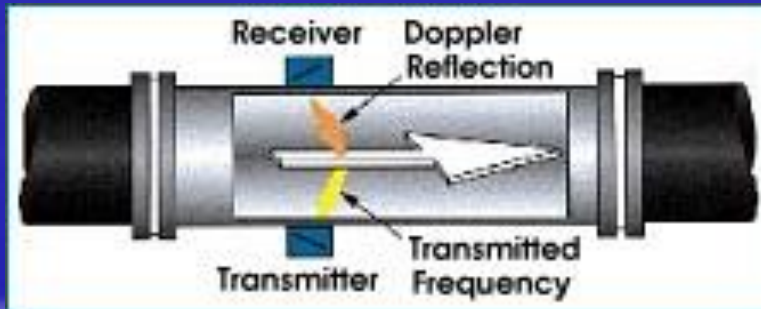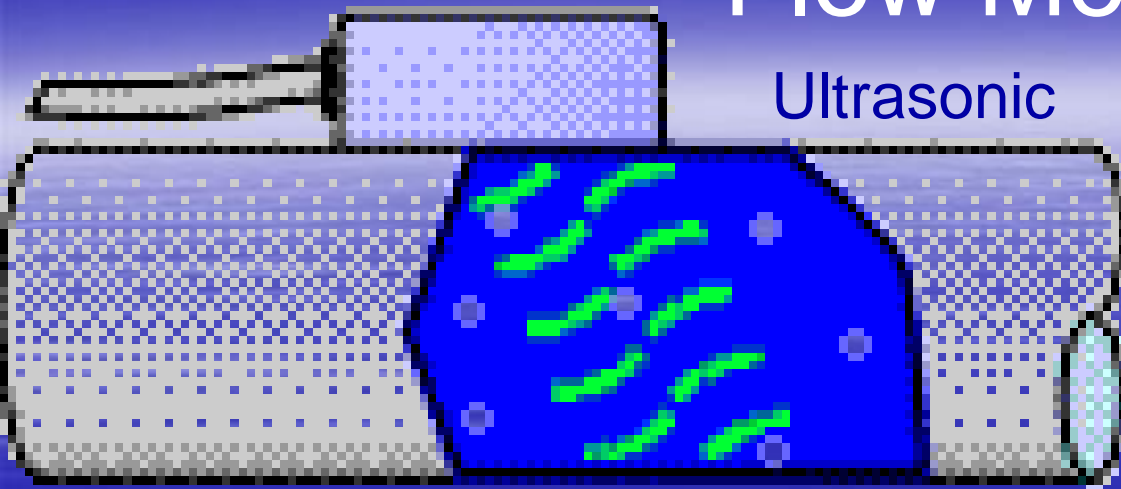

**Doppler** ultrasonic flowmeters operate on the Doppler effect, whereby the transmitted frequency is altered linearly by being reflected from particles and bubbles in the fluid. The net result is a frequency shift between transmitter and receiver frequencies that can be directly related to the flow rate.

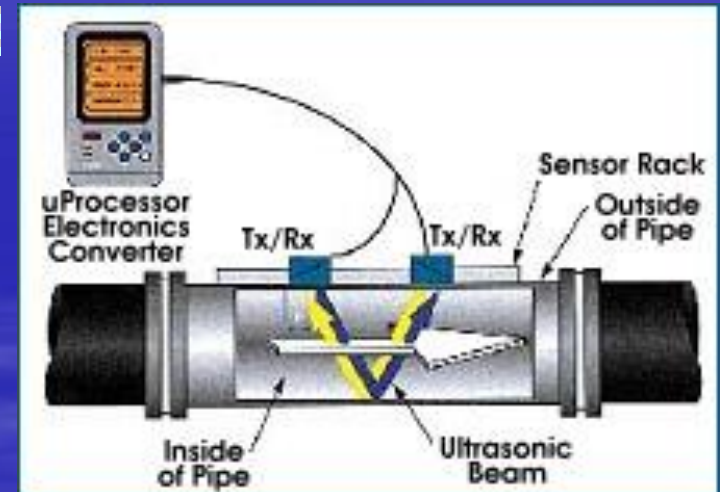

**Transit-time** flowmeters measure the difference in travel time between pulses transmitted in a single path along and against the flow. Two transducers are used, one upstream of the other. Each acts as both a transmitter and receiver for the ultrasonic beam.

Flow meter Characteristics Comparison Sheet							
Flow meter Element	Recommended Service	Turndown	Pressure Loss	Typical Accuracy(%)	Required Upstream pipe diameters	Viscosity Effect	Relative Cost
Orifice	Clean, dirty fluids; some slurries	4 to 1	Medium	±2 to ±4 of full scale	10 to 30	High	Low
Venturi tube	Clean, dirty and viscous fluids; some slurries	4 to 1	Low	±1 of full scale	5 to 20	High	Medium
Flow nozzle	Clean and dirty fluids	4 to 1	Medium	±1 to ±2 of full scale	10 to 30	High	Medium
Pitot tube	Clean fluids	3 to 1	Very low	±3 to ±5 of full scale	20 to 30	Low	Low
Elbow meter	Clean, dirty fluids; some slurries	3 to 1	Very low	±5 to ±10 of full scale	30	Low	Low
Target meter	Clean, dirty viscous fluids; some slurries	10 to 1	Medium	±1 to ±5 of full scale	10 to 30	Medium	Medium
Variable area	Clean, dirty viscous fluids	10 to 1	Medium	±1 to ±10 of full scale	None	Medium	Low
Positive Displacement	Clean, viscous fluids	10 to 1	High	±0.5 of rate	None	High	Medium
Turbine	Clean, viscous fluids	20 to 1	High	±0.25 of rate	5 to 10	High	High
Vortex	Clean, dirty fluids	10 to 1	Medium	±1 of rate	10 to 20	Medium	High
Electromagnetic	Clean, dirty, viscous conductive fluids and slurries	40 to 1	None	±0.5 of rate	5	None	High
Ultrasonic (Doppler)	Dirty, viscous fluids and slurries	10 to 1	None	±5 of full scale	5 to 30	None	High
Ultrasonic (Transit Time)	Clean, viscous fluids	20 to 1	None	±1 to ±5 of full scale	5 to 30	None	High
Mass (Coriolis)	Clean, dirty viscous fluids; some slurries	10 to 1	Low	±0.4 of rate	None	None	High
Mass (Thermal)	Clean, dirty, viscous fluids; some slurries	10 to 1	Low	±1 of full scale	None	None	High

# Metering Compound Values for reference

Some commonly metered values require multiple inputs and must be calculated, e.g.

- **Chilled water:** Tons or BTU/hr; requires volumetric flow, supply and return temperatures ( $\Delta T$ ), density compensation generally not required
- **Hot Water:** BTU/hr; same as chilled water
- **Steam Flow:** Pounds/hr or BTU/hr; requires density compensation using temperature, pressure, and heat content. Some meters can do this dynamically, but most use static values.
- **Liquid Fuel Mass or Energy Flow:** Natural gas or fuel oils; requires density compensation using temperature, pressure, and heat content.
- **Solid Fuel Mass or Energy Flow:** Coal or wood; requires mass and heat content

# Monitoring

## Collecting and organizing the data for use

- Manual Data Collection
  - Assign responsibility (who)
  - Locate all meters to be read (where)
  - Learn how to read the meters (how)
  - Determine the frequency of data collection (when)
  - Create data collection forms (what)
  - Plan for future automated collection, i.e. use tablets, netbooks, Microsoft Excel or Access.

# Monitoring

- **Automated Data Acquisition**
  - *The automated retrieval of field data from remote locations to a centralized data storage location.*
  - *Components include both hardware and software*




# Monitoring – for reference

## ■ Automated Data Acquisition **Hardware**

- **Programmable Logic Controllers (PLCs)**: Devices located near the sensors that have the capability to collect and process local data for download to a central storage location
- **“Smart” Meters**: Devices that contain software that allow them to process, connect and download data directly to the network
- **Network Connection Devices**: Interface between the various field device data transfer protocols (Modbus, ControlNet, BacNet, TCP/IP, etc) and the network (phone, wireless, ethernet, etc.)
- **Database Servers**: computer(s) used to store the data for real-time, historical, and archival use.
- **Firewalls**: computer(s) used solely to limit access to the servers and data collection network
- **Workstation(s)**: other computers that can connect to the database servers to disseminate and process collected data
- **Wiring**: between field devices internal to building, between buildings. 4-20 mA, Cat5e, RS485, etc. Need to chose whether to use campus WAN or install dedicated network

# Building Data Hardware

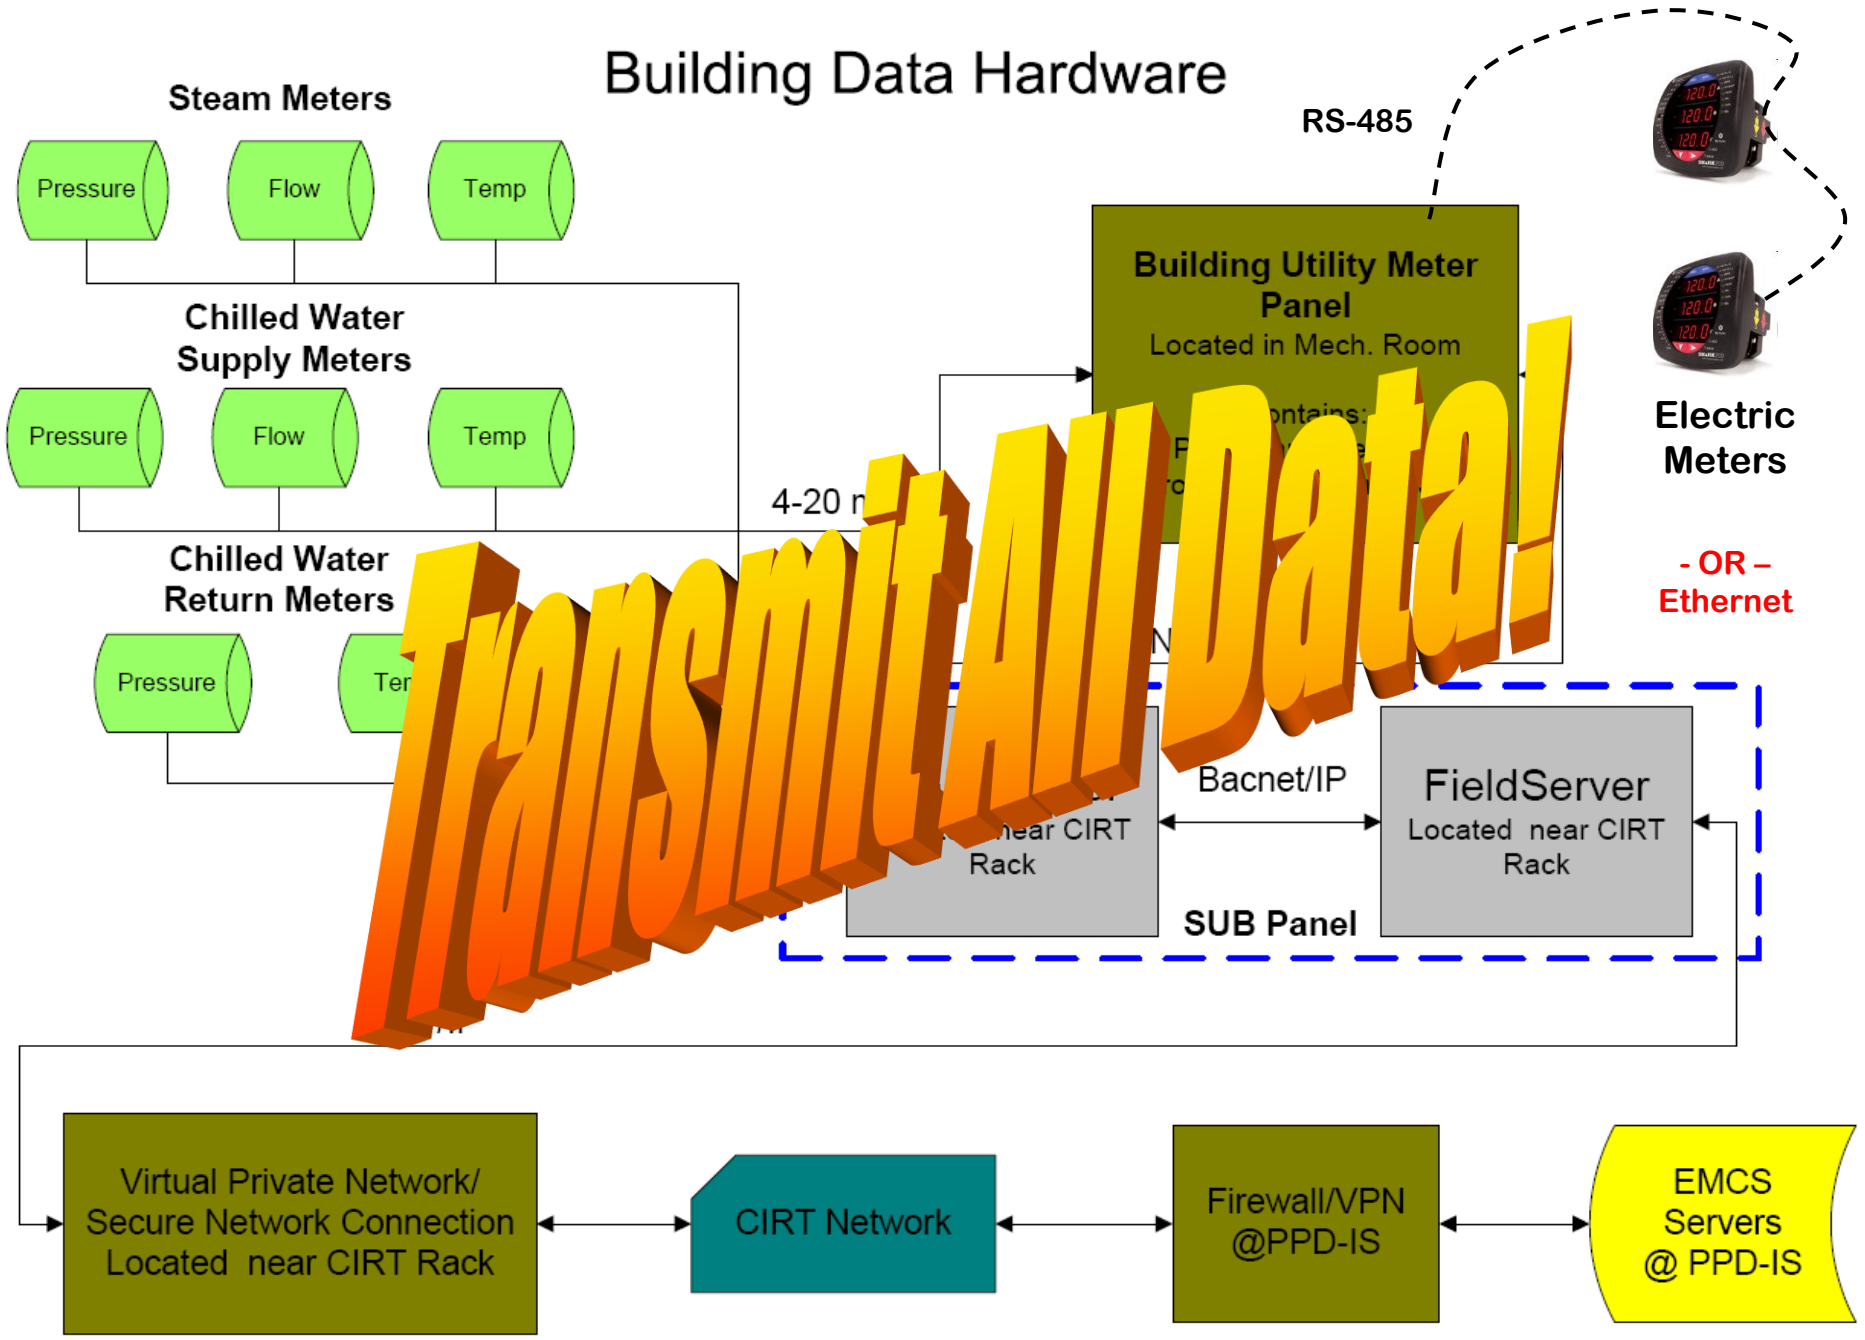

# Monitoring

## *Transmit All Data!*


- Chilled Water BTU = 0
  - *Flow = 0*
  - *Supply Temp = 0*
  - *Return Temp = 0*
    - *Both = 0*
  - *Supply Pressure = 0*
  - *Return Pressure = 0*
    - *Both = 0*

# Monitoring – for reference

## ■ Automated Data Acquisition **Software**

- **PLC Programming**: software necessary to program PLCs to process data, e.g. convert flow and temperature into BTU's, read field input terminals, load data into storage registers, upload data to other devices, etc.
- **Device Calibration**: software required to configure field sensors and devices, e.g. pipe size, fluid properties, etc.
- **Protocol Converters**: software interface modules to convert between the various field device data transfer protocols (Modbus, ControlNet, BacNet, TCP/IP, etc)
- **Database Manager**: software used to organize and relate the data for end-use, e.g. MSSQL, MySQL, Oracle, etc.
- **Firewall**: software used to set up authorized access to the database manager, e.g. Kerio, Cisco, etc.
- **Workstation**: software used to disseminate and gather the field data, e.g. web server, visualization, scheduler, etc.

# EMIS

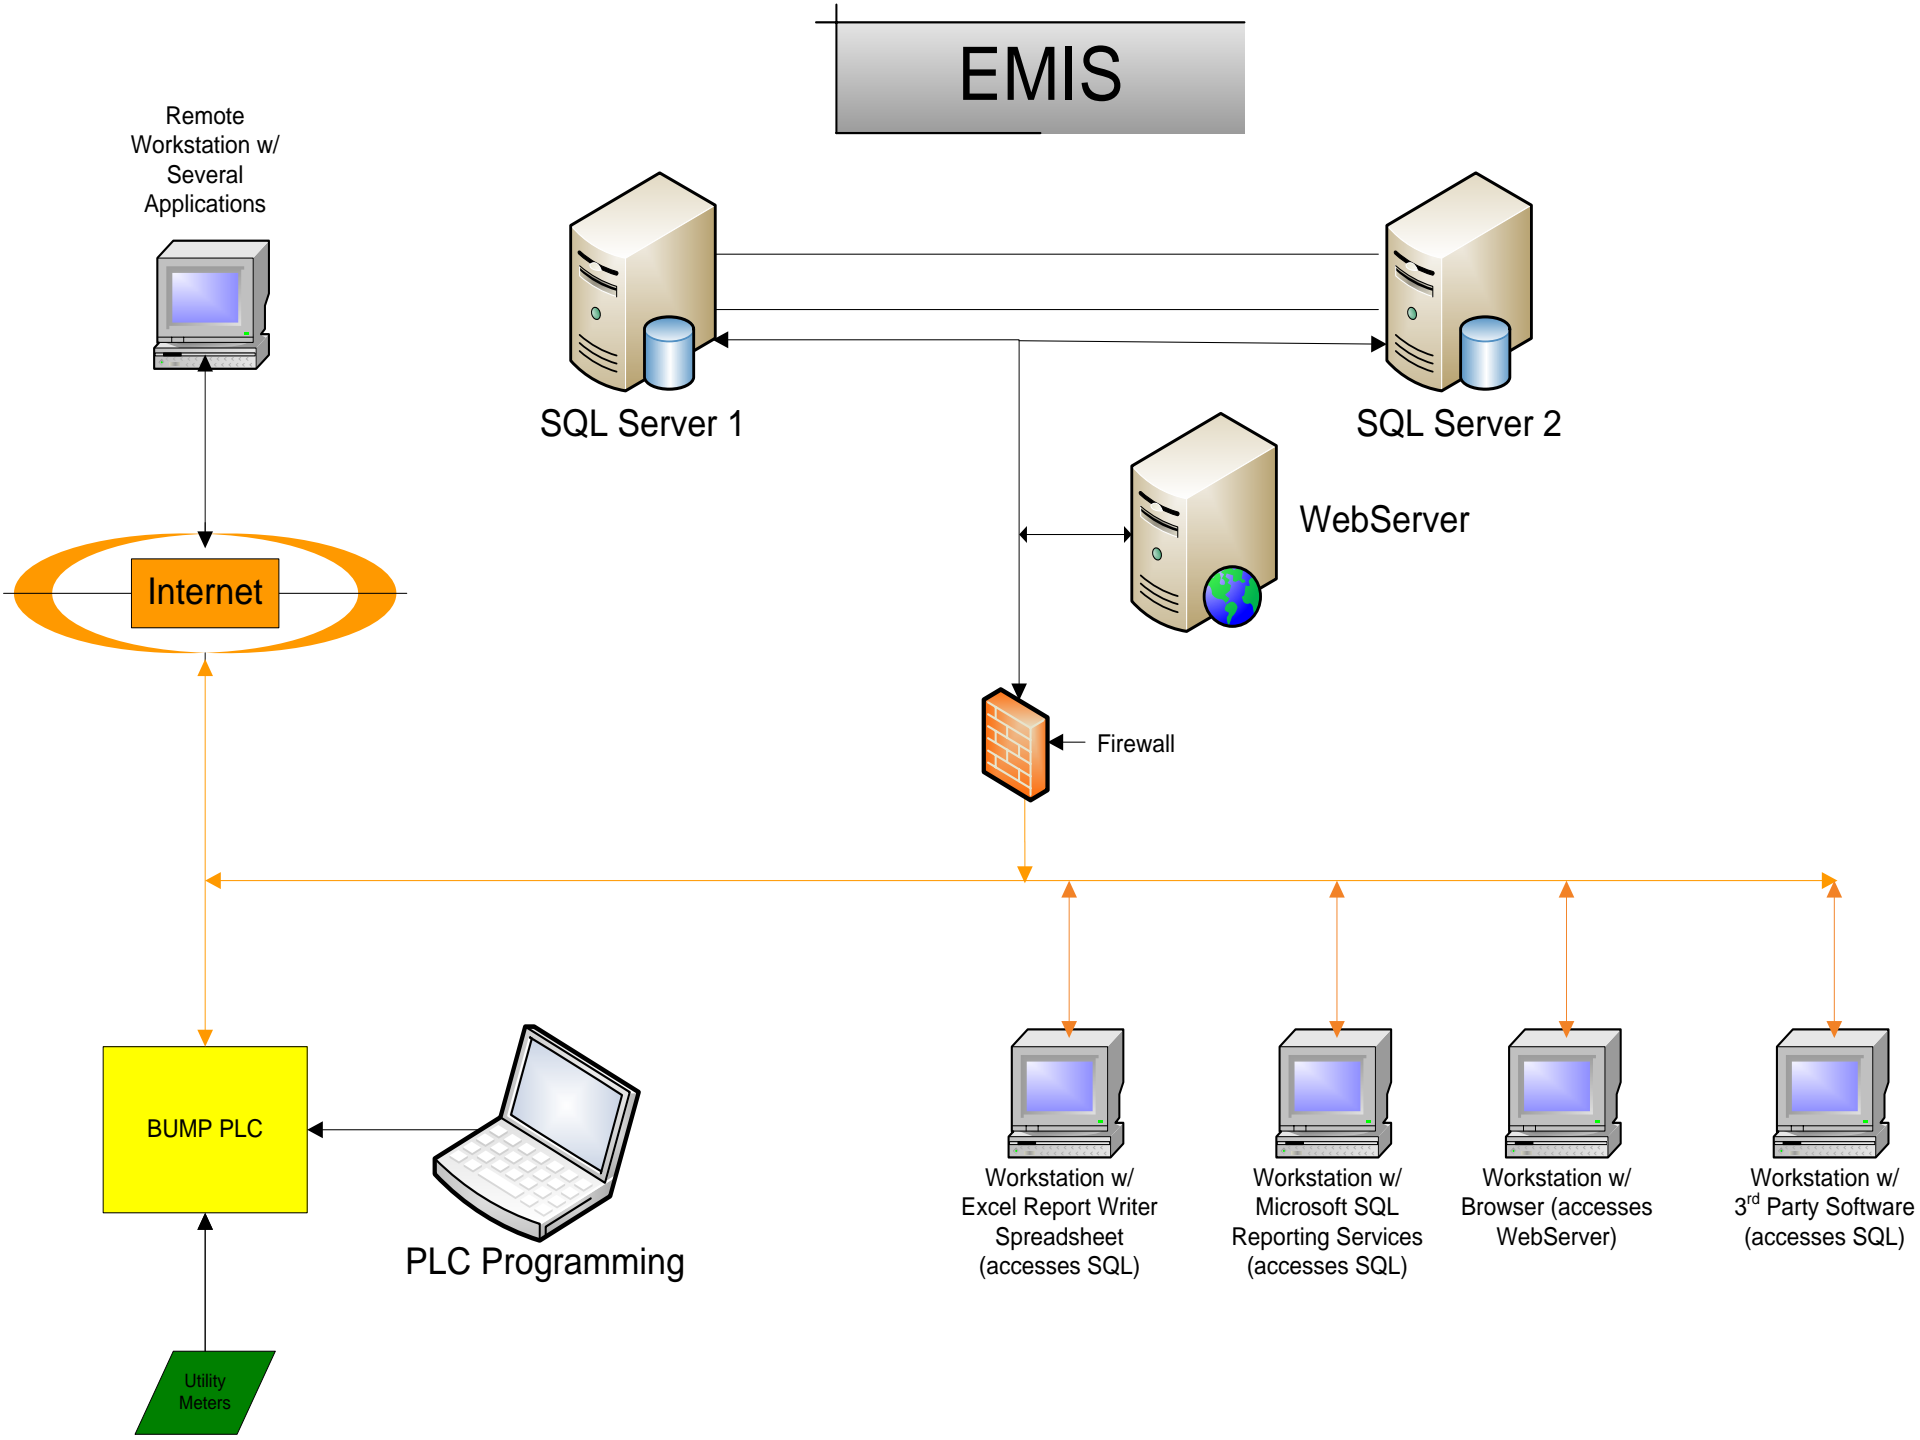

# Verification


- **Energy Management Information System (EMIS):**  
**Convert DATA into INFORMATION**
  - Gather dispersed and disparate production, energy use (both billing and meter) and budget energy data from multiple sites, multiple energy suppliers and different types of energy suppliers.
  - Validate the data and manage missing or erroneous data.
  - Convert the raw data into usable management information, particularly meaningful Key Performance Indicators (KPIs).
  - Generate meaningful reports that include the analysis of trends and exceptions.
  - Distribute the analyses and reports across multiple sites, internally and externally, in a timely fashion.

# Verification


- Metrics Examples

Convert INFORMATION into KNOWLEDGE


– Example Applications

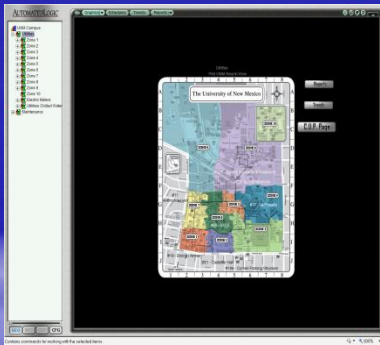


*Data Analysis  
Report Writer*

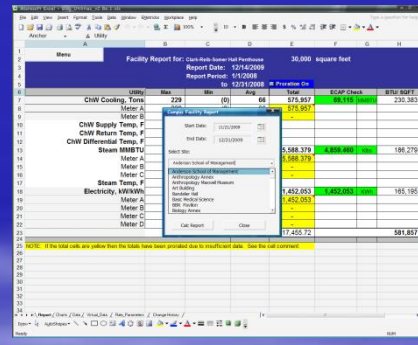

*Statistical Analysis*

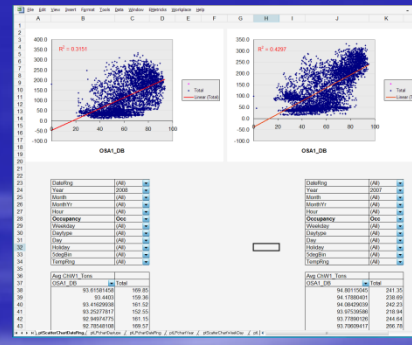

*Real-Time Web  
Viewer*

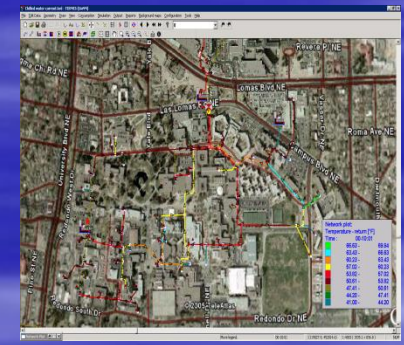

*Data Provisioning  
to 3rd Party  
Applications*

- UNM Campus
  - Utilities
    - Zone 1
      - Hodgin Hall Bump
      - ME Building Bump
      - Farris Engineering
      - Regener Hall Bump
      - Logan Hall Bump
      - Biology Annex Bump
      - EECE Bump Panel
      - Centennial\_Engineering
    - Zone 2
    - Zone 3
    - Zone 4
    - Zone 5
    - Zone 6
    - Zone 7
    - Zone 8
    - Zone 9
    - Zone 10
    - Electric Meters
    - Utilities Chilled Water
    - Maintenance

### BUILDING UTILITY METERING PANEL

Centennial\_Engineering

Viewing: Meter #1

Meter: F1 F2

### VALUES

Phase A Current	35.00 Amps
Phase B Current	83.00 Amps
Phase C Current	71.00 Amps
Volts, Phase A to B	211.00 Volts
Volts, Phase C to N	122.00 Volts
Kilowatts	21.00 Kw
Neutral Current	25.00 Amps
Kilowatt Demand	22.00 Kw
MegaWatt Hours	255.95 Mhrs
Neutral Harmonic Content	81.20 %

### SETPOINTS

Volts (A-B) Low	0.00 Volts
Volts (A-B) High	0.00 Volts
Volts (C-N) Low	0.00 Volts
Volts (C-N) High	0.00 Volts

### ALARMS


Phase A Fault	Off
Phase B Fault	Off
Phase C Fault	Off
E-Meter General Alarm	Off
Volts (A-B) Low	Off
Volts (A-B) High	Off
Volts (C-N) Low	Off
Volts (C-N) High	Off

Go To:

- [Chilled Water](#)
- [Natural Gas & Dom. Water](#)
- [Steam & Condensate](#)
- [Elec. Bumps](#)
- [All Alarms](#)
- [Main BUMP Front](#)
- [Utilities Map](#)





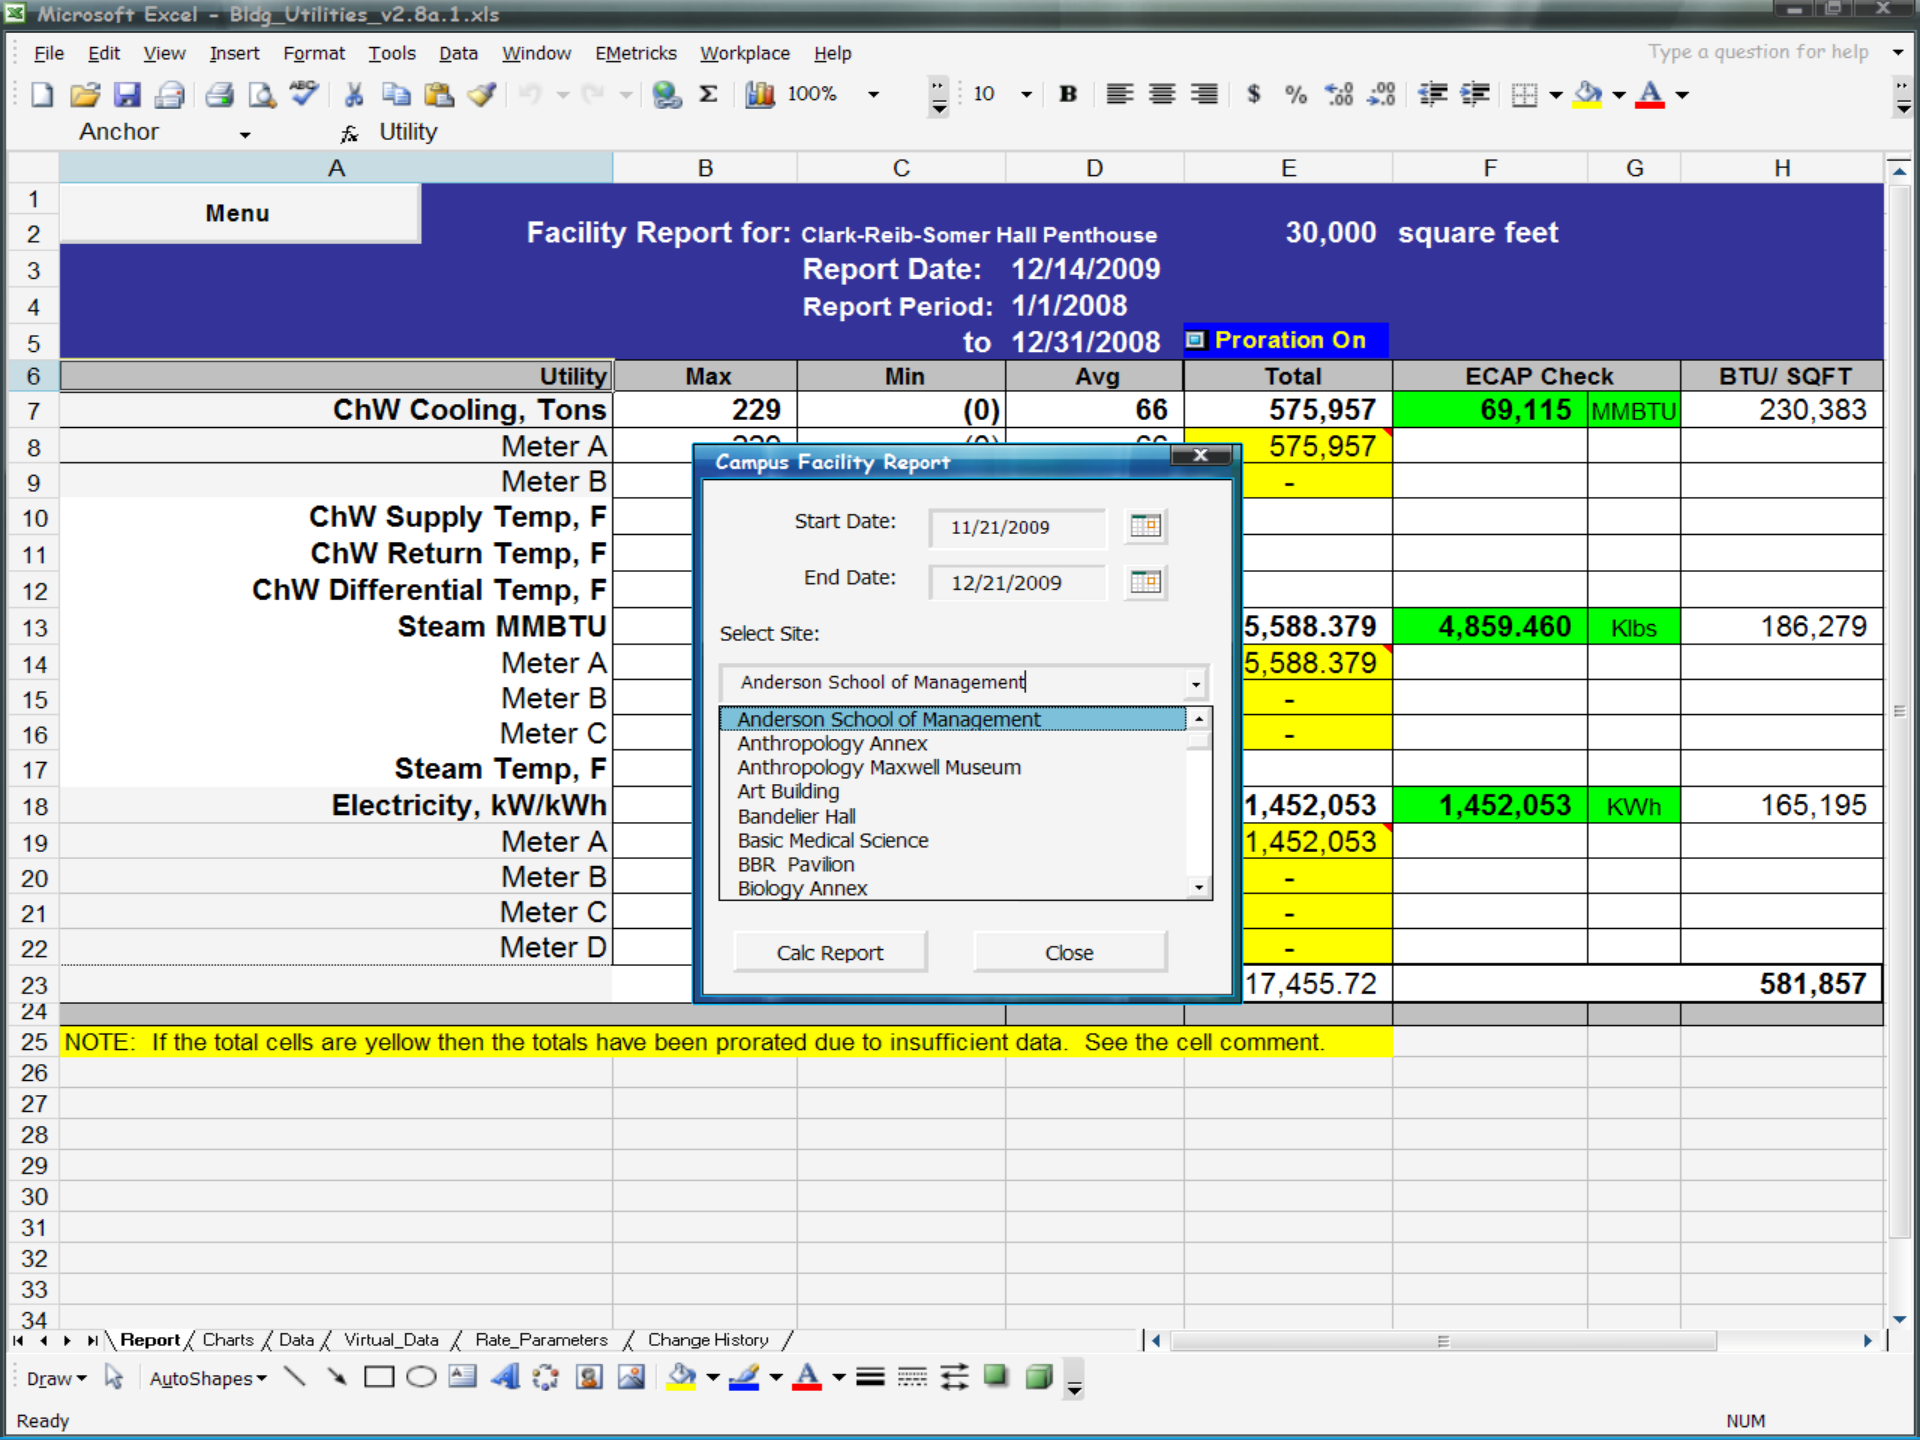

Menu	<b>Facility Report for: Clark-Reib-Somer Hall Penthouse</b> <b>Report Date: 12/14/2009</b> <b>Report Period: 1/1/2008</b> <b>to 12/31/2008</b> <input checked="" type="checkbox"/> Proration On	<b>30,000 square feet</b>
------	--	---------------------------

Utility	Max	Min	Avg	Total	ECAP Check	BTU/ SQFT
<b>ChW Cooling, Tons</b>	229	(0)	66	575,957	69,115 MMBTU	230,383
Meter A				575,957		
Meter B				-		
<b>ChW Supply Temp, F</b>						
<b>ChW Return Temp, F</b>						
<b>ChW Differential Temp, F</b>						
<b>Steam MMBTU</b>				5,588.379	4,859.460 Klbs	186,279
Meter A				5,588.379		
Meter B				-		
Meter C				-		
<b>Steam Temp, F</b>						
<b>Electricity, kW/kWh</b>				1,452,053	1,452,053 kWh	165,195
Meter A				1,452,053		
Meter B				-		
Meter C				-		
Meter D				-		
				17,455.72		581,857

**Campus Facility Report**

Start Date:

End Date:

Select Site:

Anderson School of Management

Anderson School of Management

Anthropology Annex

Anthropology Maxwell Museum

Art Building

Bandelier Hall

Basic Medical Science

BBR Pavilion

Biology Annex

NOTE: If the total cells are yellow then the totals have been prorated due to insufficient data. See the cell comment.

**Modify Chart Ranges** [X]

◀
█
▶






Number of Points



◀
█
▶

Scroll Time

otTable [Icons] 10 [B] [List Icons]


K L M N O P Q R S T U V W

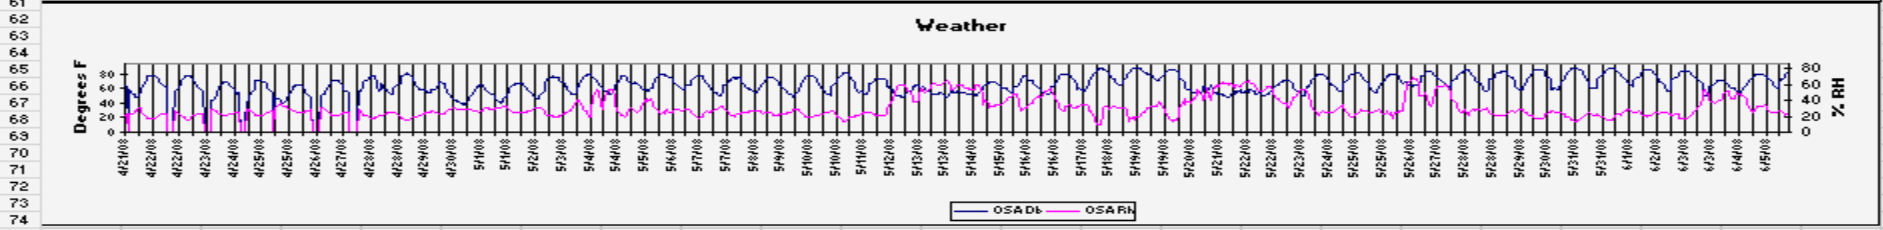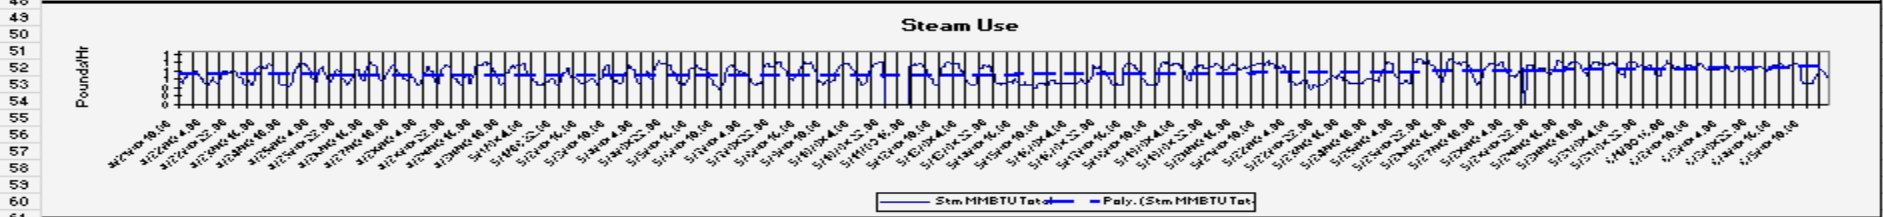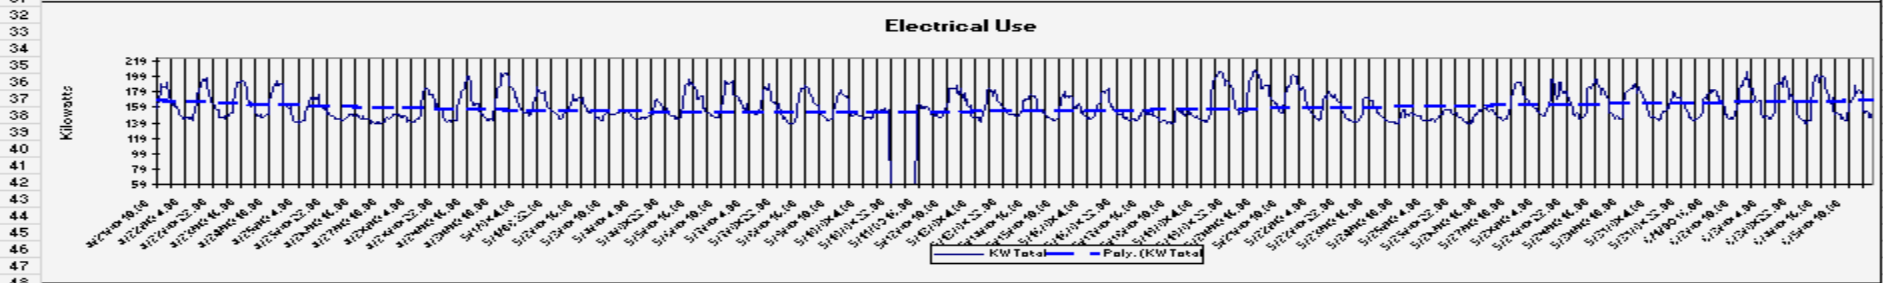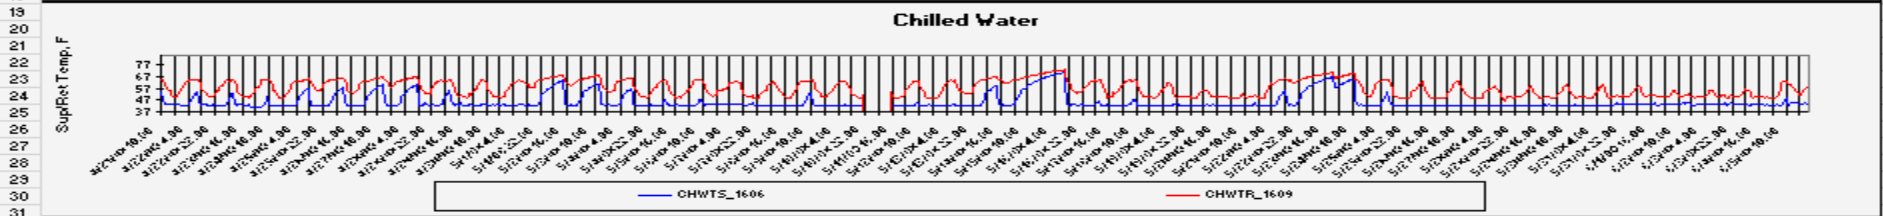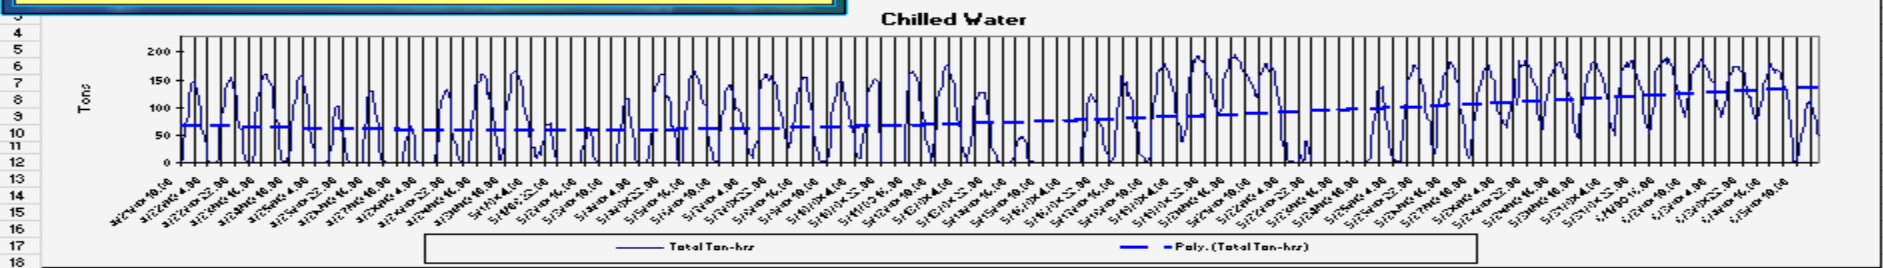

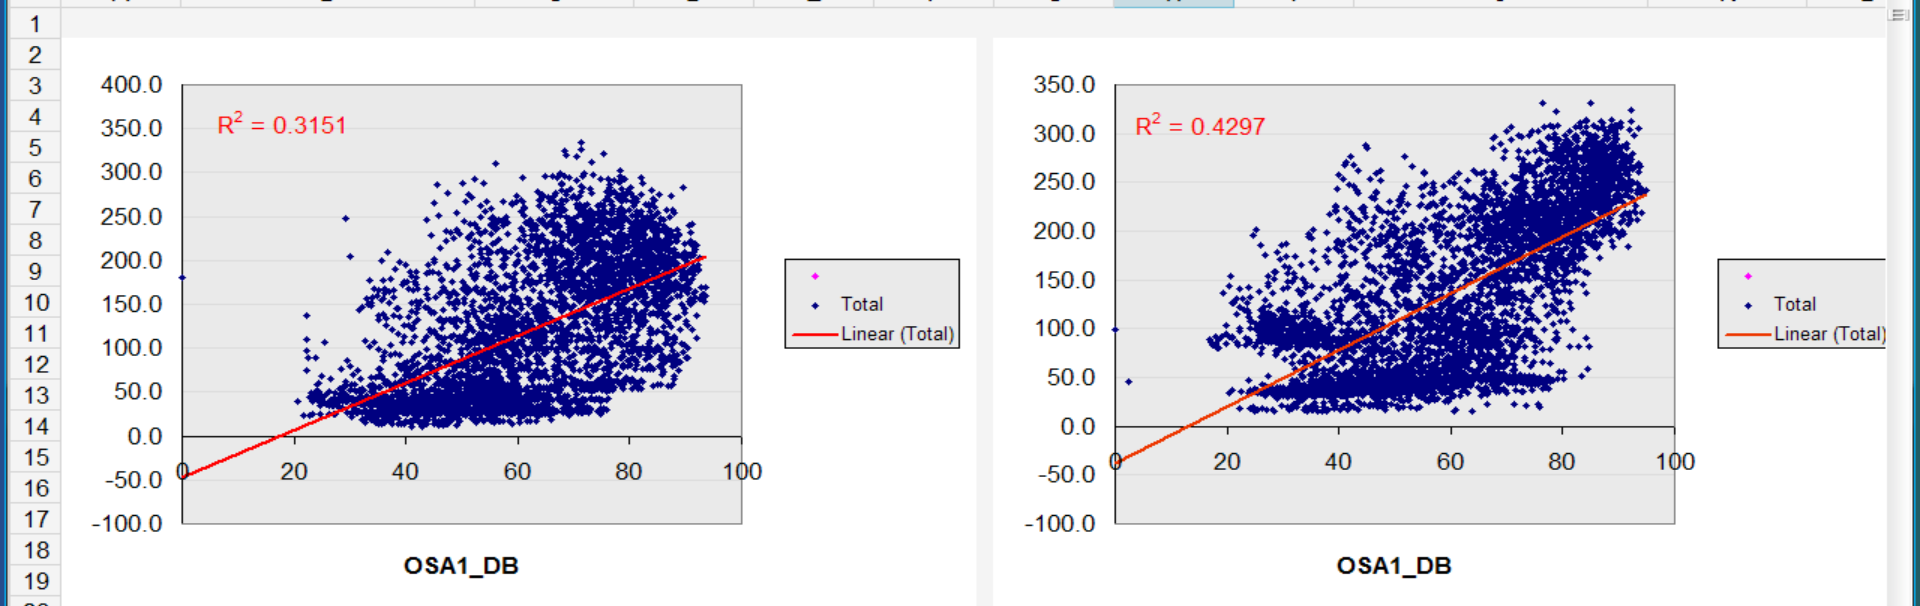


DateRng	(All)	▼
Year	2008	▼
Month	(All)	▼
MonthYr	(All)	▼
Hour	(All)	▼
<b>Occupancy</b>	<b>Occ</b>	▼
Weekday	(All)	▼
Daytype	(All)	▼
Day	(All)	▼
Holiday	(All)	▼
5degBin	(All)	▼
TempRng	(All)	▼

Avg ChW1_Tons		
OSA1_DB	▼	Total
93.61581458		169.85
93.4403		159.36
93.41629938		161.52
93.25277817		152.55
92.94974775		161.15
92.78548108		169.57



DateRng	(All)	▼
Year	2007	▼
Month	(All)	▼
MonthYr	(All)	▼
Hour	(All)	▼
<b>Occupancy</b>	<b>Occ</b>	▼
Weekday	(All)	▼
Daytype	(All)	▼
Day	(All)	▼
Holiday	(All)	▼
5degBin	(All)	▼
TempRng	(All)	▼

Avg ChW1_Tons		
OSA1_DB	▼	Total
94.80115045		241.35
94.17880401		238.69
94.08429039		242.23
93.97539586		218.94
93.77890126		244.64
93.70609417		266.78

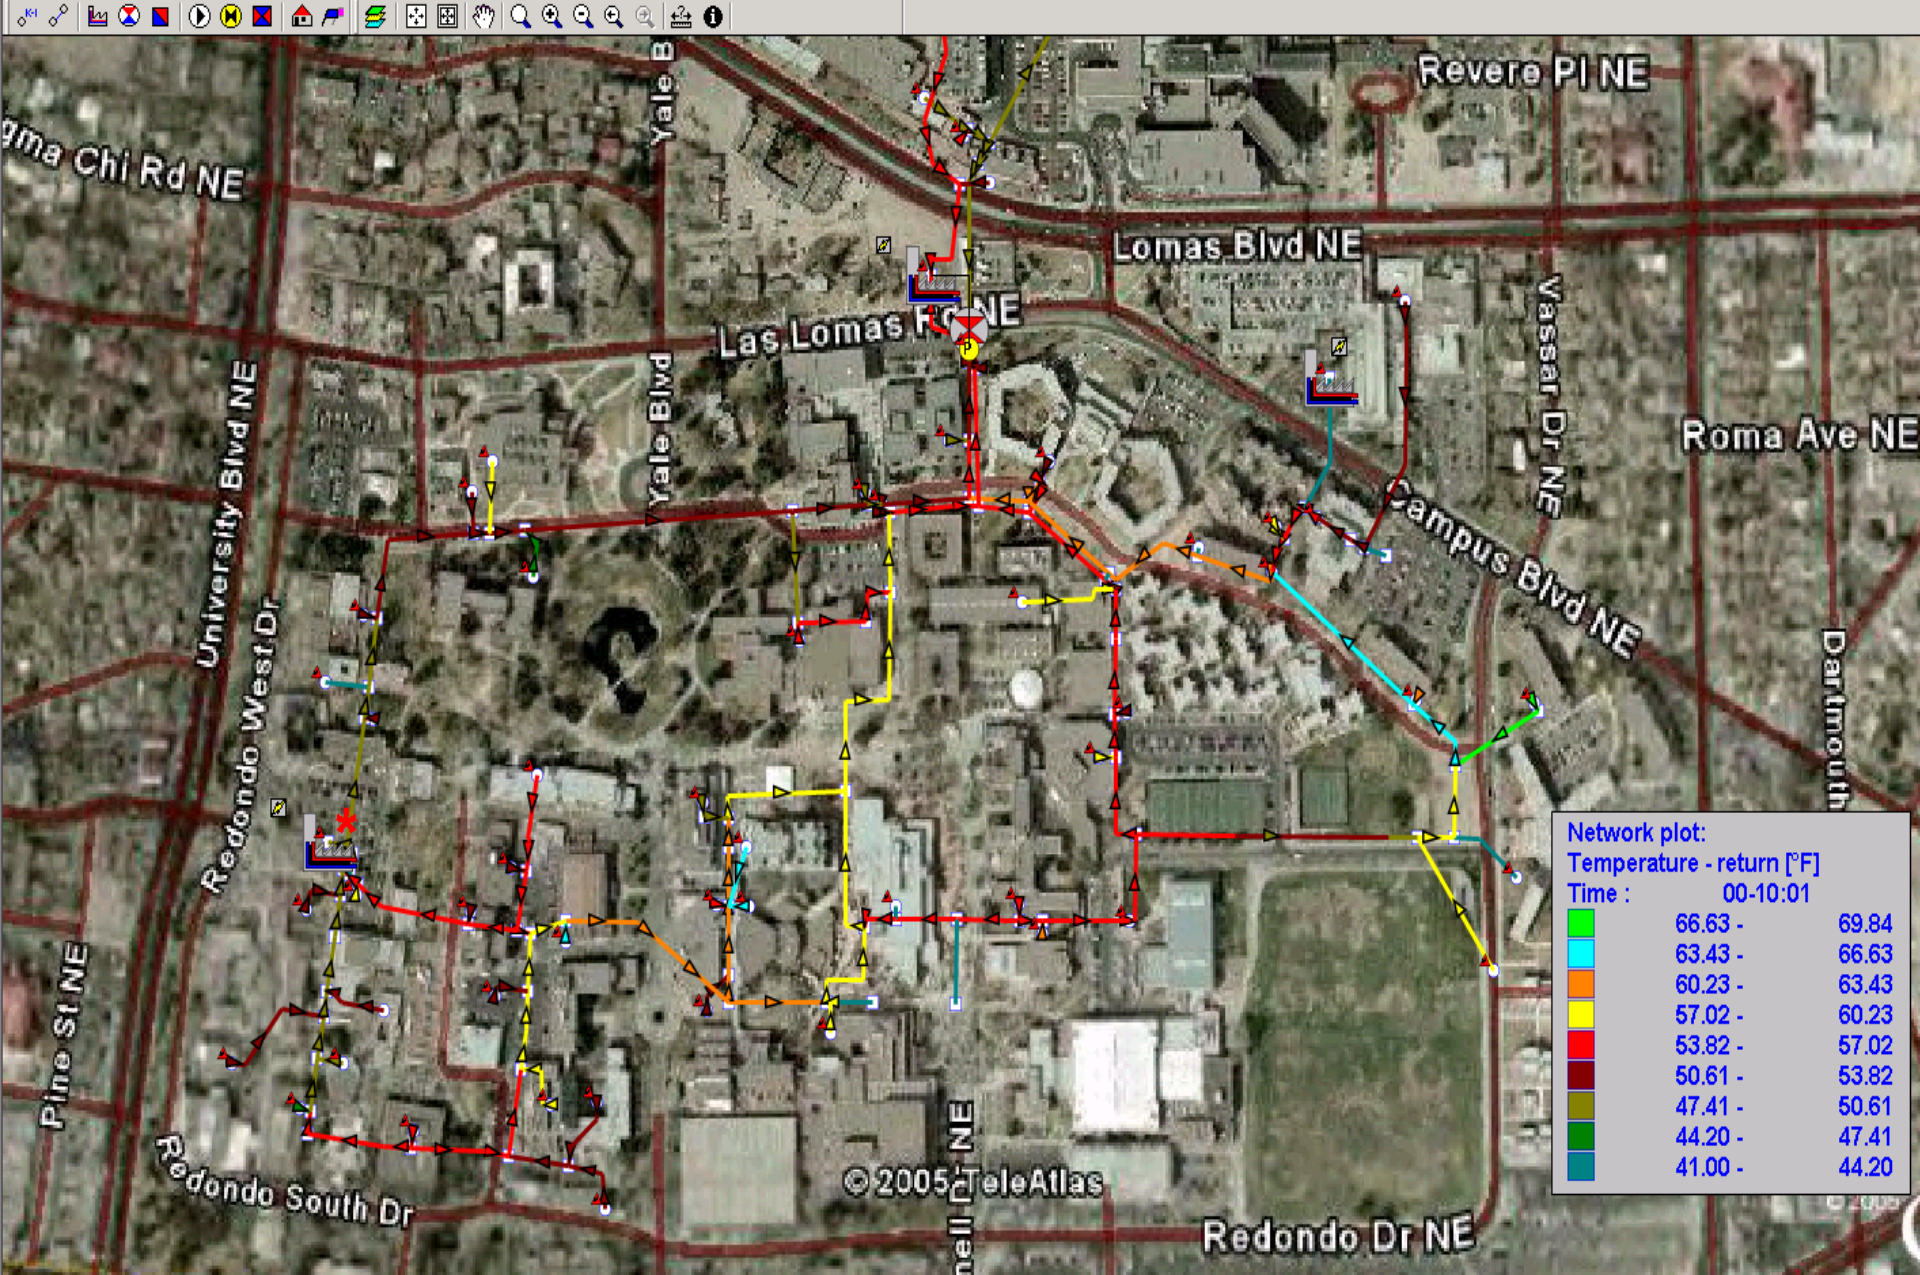

**Network plot:**  
 Temperature - return [°F]  
 Time : 00-10:01

66.63 - 69.84
63.43 - 66.63
60.23 - 63.43
57.02 - 60.23
53.82 - 57.02
50.61 - 53.82
47.41 - 50.61
44.20 - 47.41
41.00 - 44.20

# Questions & Answers

Thank You!

